

# City of Detroit VOC Sampling Progress Map

## Samples Not Required

The property was not damaged in the fire, so no VOC samples were required. Mainline samples cleared the property as not contaminated with VOCs.

## Sampled - Awaiting Results

VOC samples were required at this property and have been taken, but no results have yet been received.

## Sampled - Not Contaminated

VOC sample results did not contain dangerous concentrations of any compounds, and no unpleasant taste or odor is anticipated.

## Sampled - Unsafe Contamination

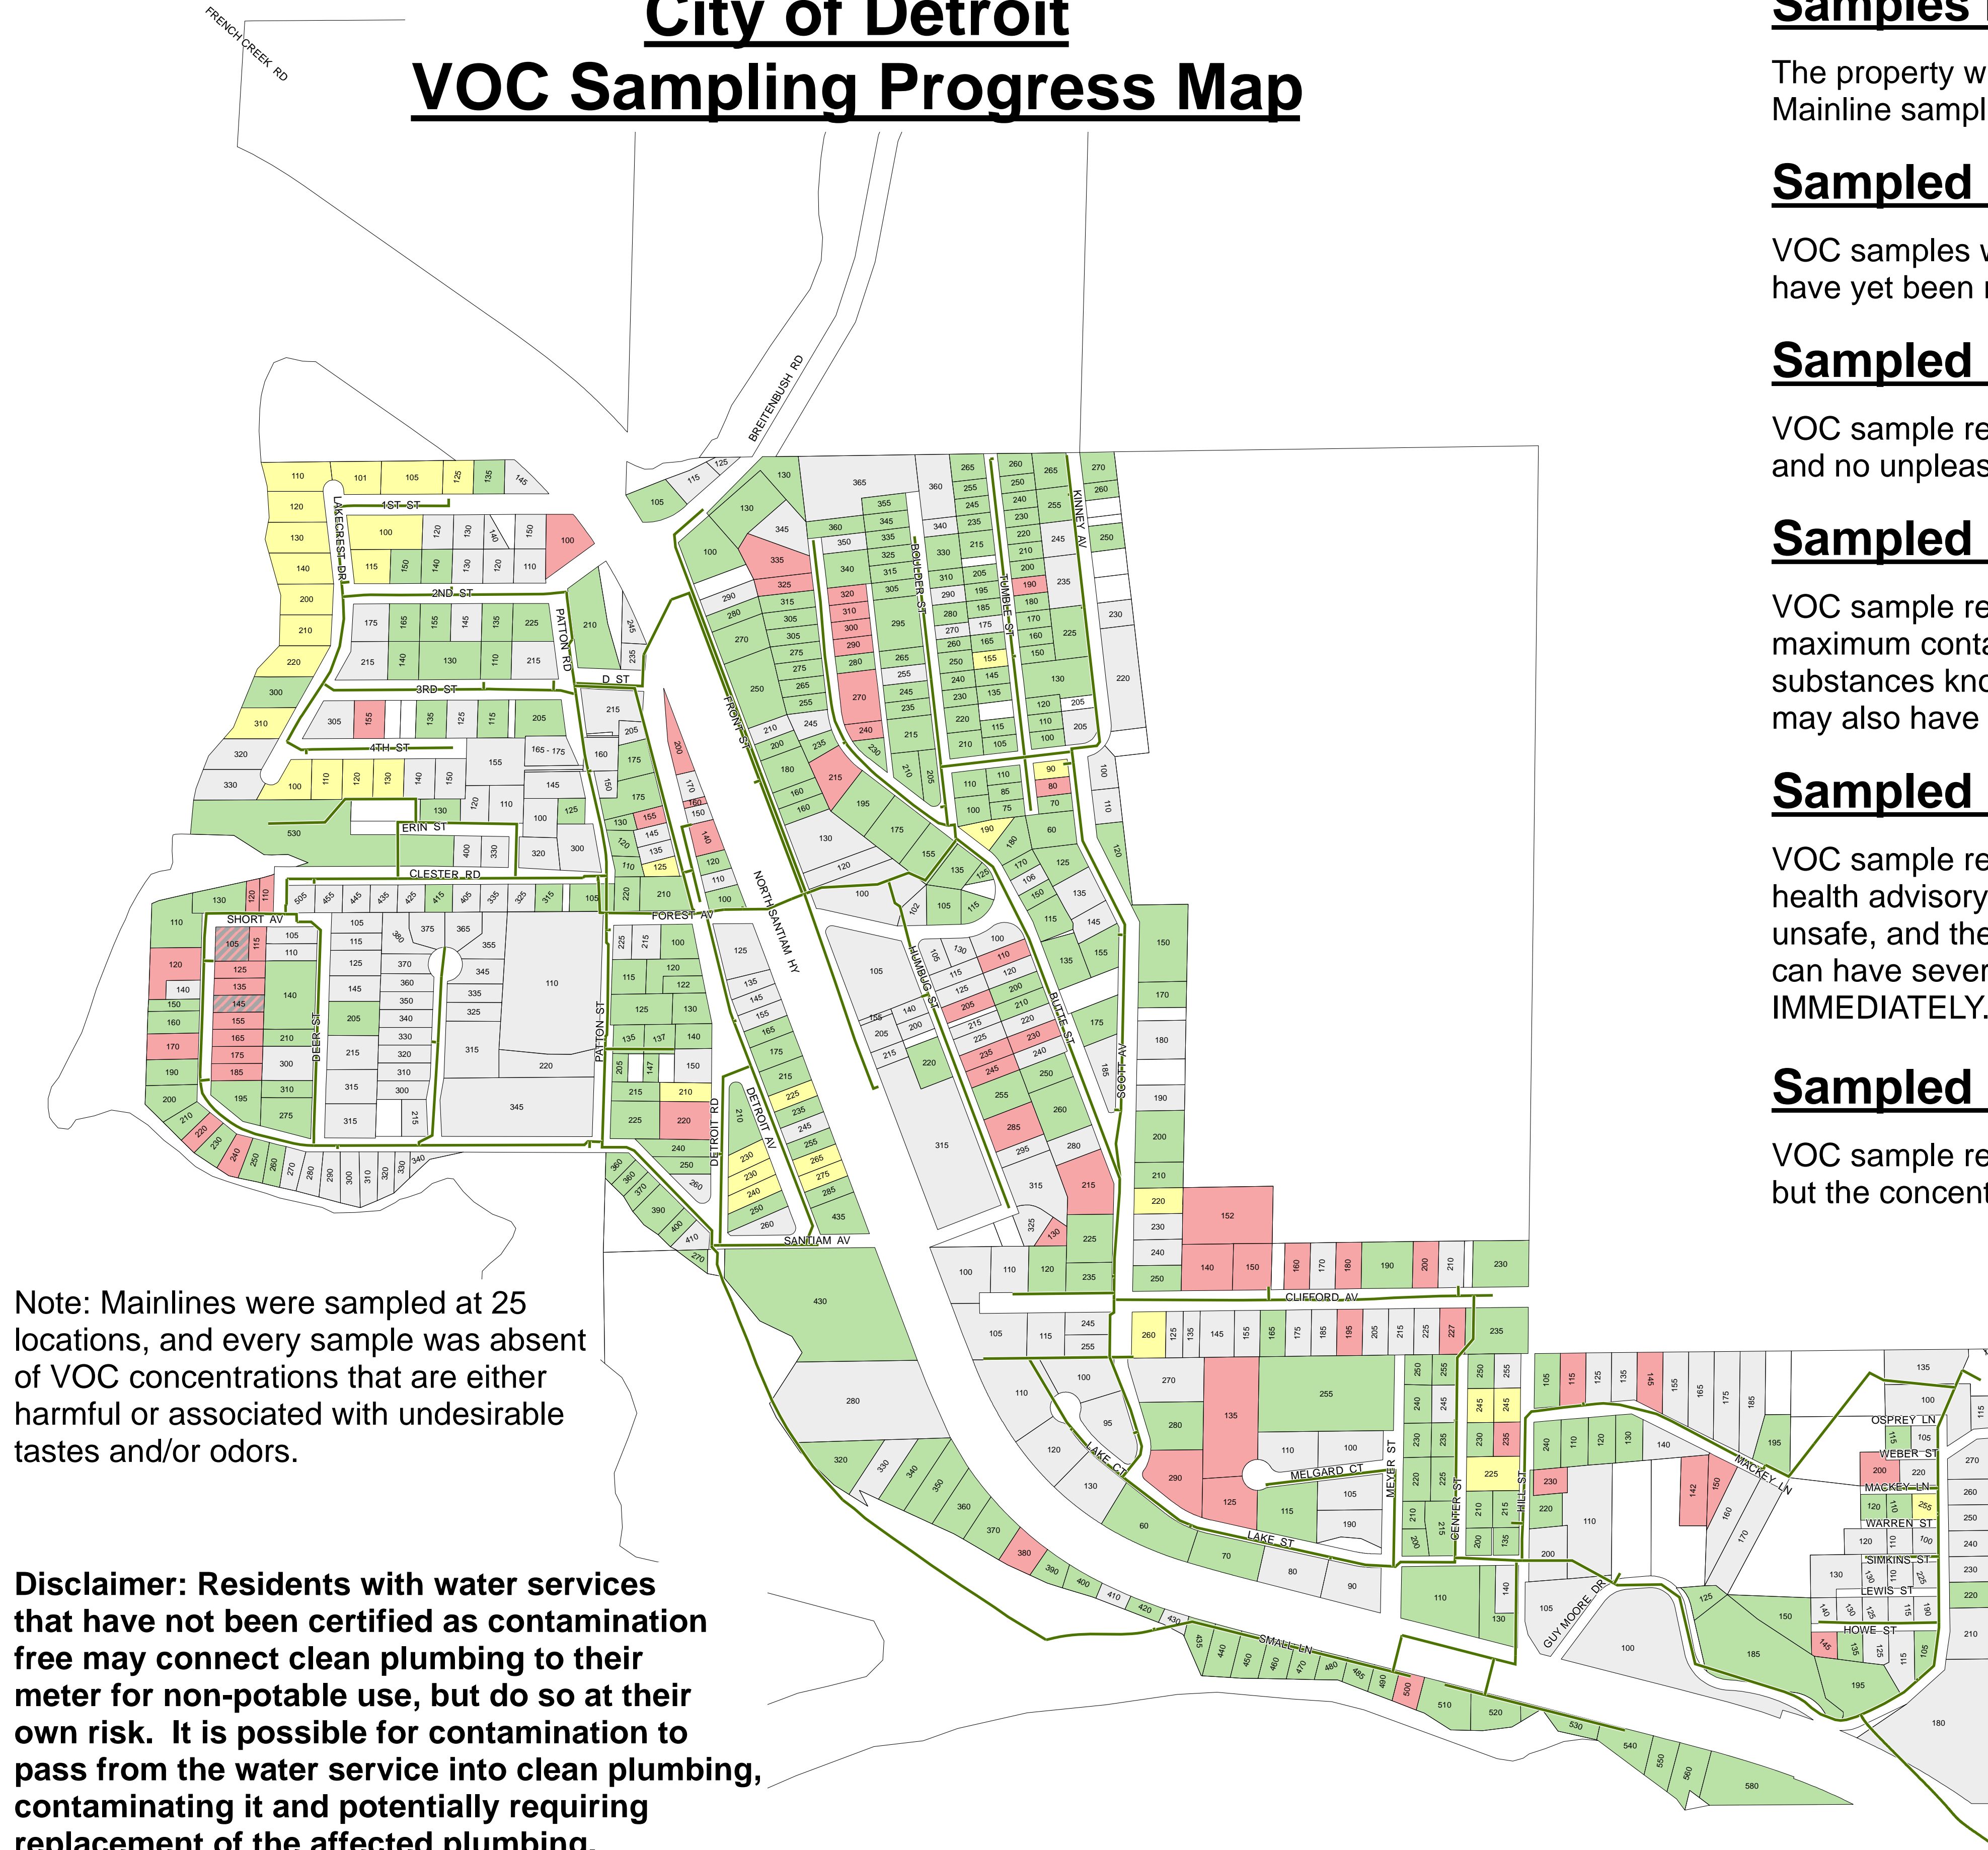
VOC sample results included concentrations of regulated substances above the maximum contamination level (MCL) and/or concentrations of unregulated substances known to be unsafe. This water is unsafe for contact/consumption, and may also have a foul taste or odor.

## Sampled - Acute Health Risk

VOC sample results included concentrations of regulated substances above the health advisory level (HAL) for 1 and 10 day exposure. This water is extremely unsafe, and the City will disconnect your water for your safety. Short term use can have severe health effects. If your water service is on, CONTACT THE CITY IMMEDIATELY.

## Sampled - Poor Taste and/or Odor









VOC sample results did not contain dangerous concentrations of any compounds, but the concentrations present will produce unpleasant odor and/or taste in the water.



Note: Mainlines were sampled at 25 locations, and every sample was absent of VOC concentrations that are either harmful or associated with undesirable tastes and/or odors.

**Disclaimer:** Residents with water services that have not been certified as contamination free may connect clean plumbing to their meter for non-potable use, but do so at their own risk. It is possible for contamination to pass from the water service into clean plumbing, contaminating it and potentially requiring replacement of the affected plumbing.

## Legend

-  Taxlots
-  Samples Not Required
-  Sampled - Awaiting Results
-  Sampled - Not Contaminated
-  Sampled - Unsafe Contamination
-  Sampled - Acute Health Risk
-  Sampled - Poor Taste and/or Odor
-  Distribution System - Not Contaminated